


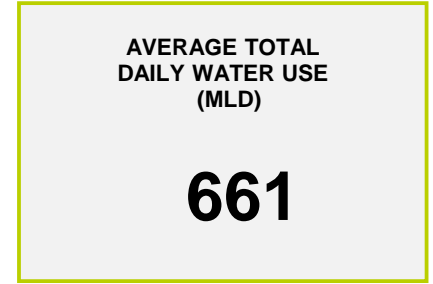
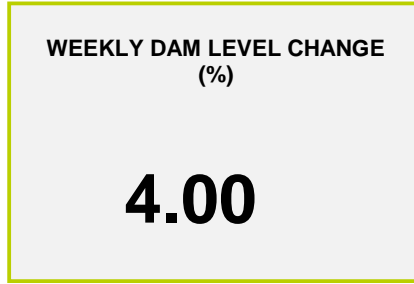


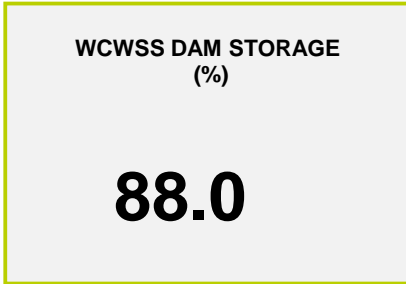


Headline Statistics

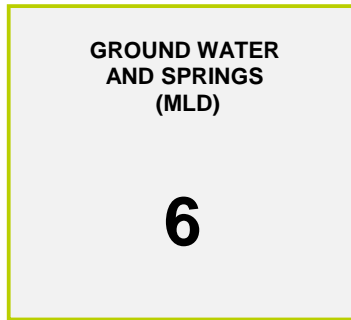

Water Production from Different Sources

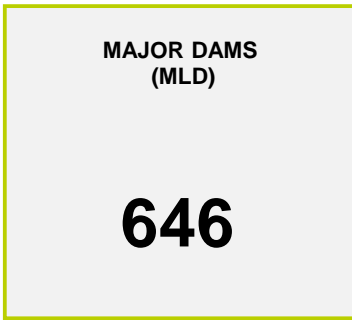

Overall Water Usage Trend (2010 - Present)

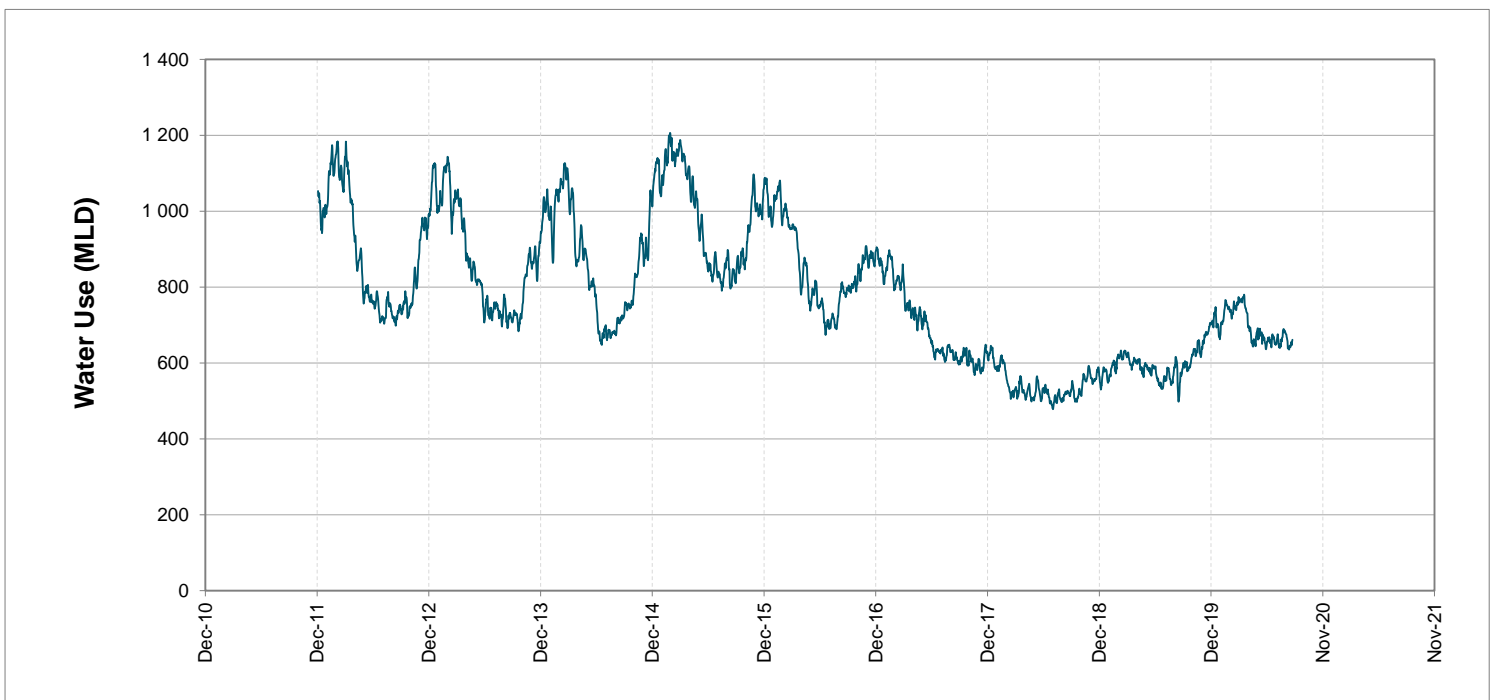

WCWSS means Western Cape Water Supply System

MLD means million litres per day

More information on Water Saving and Restrictions is available on the City of Cape Town's 'ThinkWater' website


Water Stored in Major Dams (WCWSS)

Overall Percentage Full **88.0%**


Weekly Change **4.0%**

MAJOR DAMS (WCWSS)	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	24 August 2020	Previous week	2019	2018	2017	2016
BERG RIVER	130 010	100.4	101.2	99.8	90.4	53.7	67.3
STEENBRAS LOWER	33 517	95.3	91.7	101.2	71.9	31.7	66.1
STEENBRAS UPPER	31 767	98.9	100.9	95.2	102.3	102.2	100.2
THEEWATERSKLOOF	480 188	85.1	80.7	72.1	44.8	25.9	51.9
VOËLVLEI	164 095	84.5	76.6	86.9	65.4	23.7	61.3
WEMMERSHOEK	58 644	84.1	80.5	87.8	82.8	40.9	70.3
TOTAL STORED	898 221	790 658	754 690	734 063	545 015	300 154	532 480
% STORAGE		88.0%	84.0%	81.7%	60.7%	33.4%	59.3%




WCWSS Storage Record (2008 - Present)

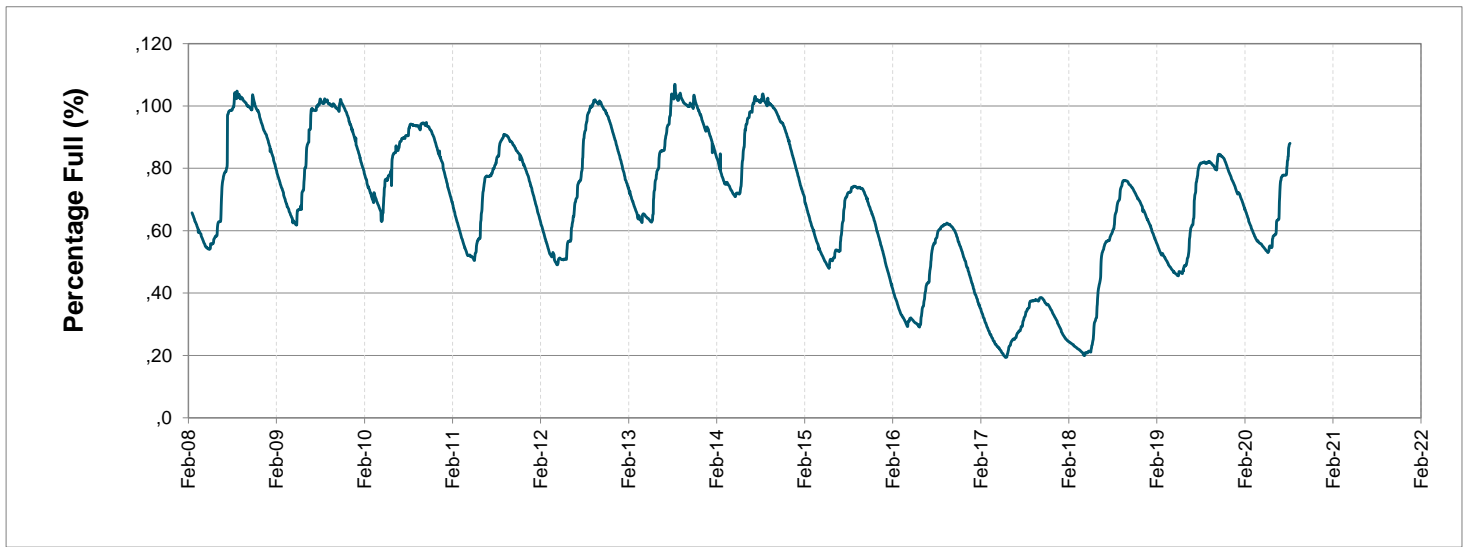

WCWSS Comparative Storage Graph (5 Years)

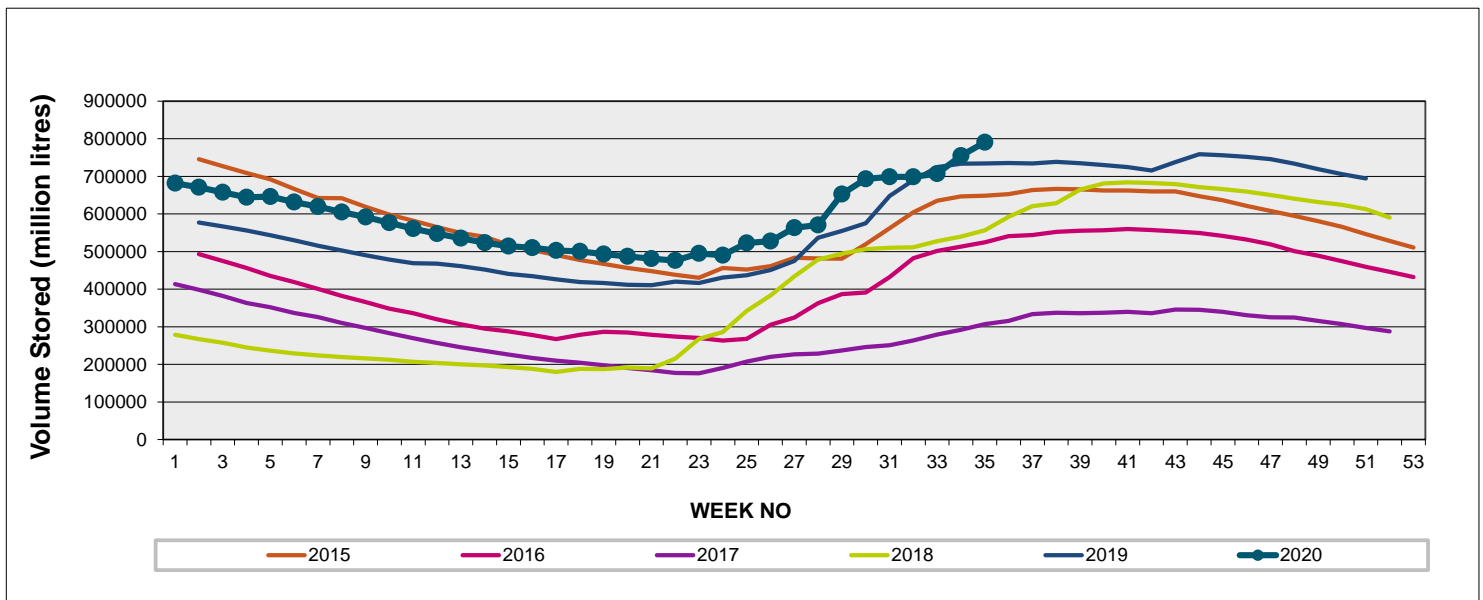

WCWSS Dam Storage and Water Use Tracking

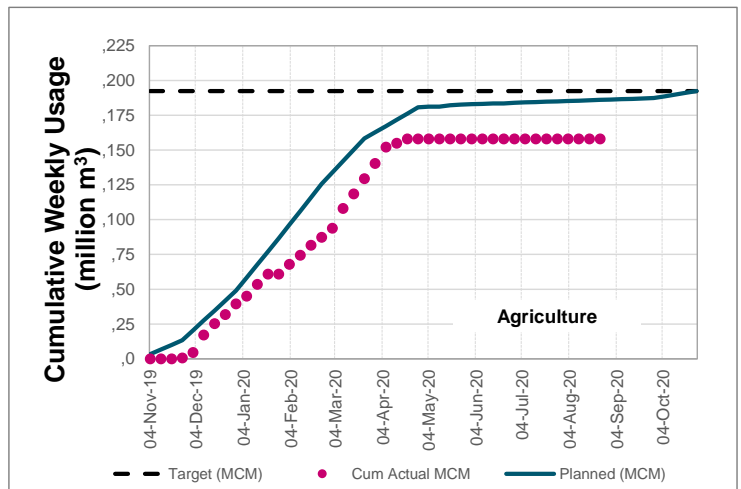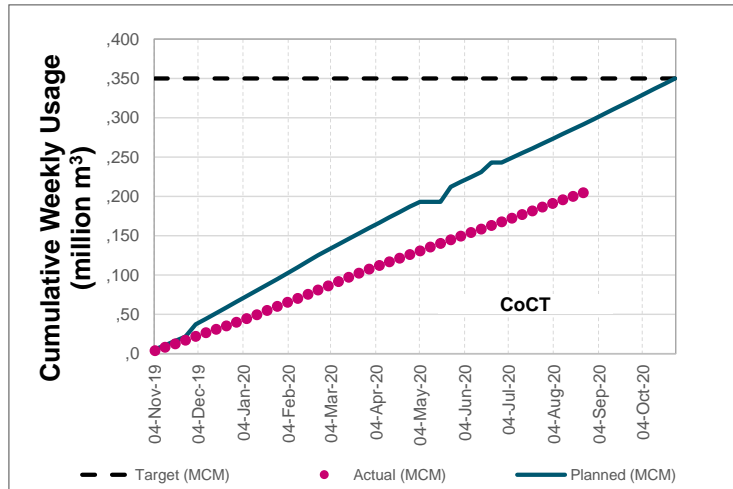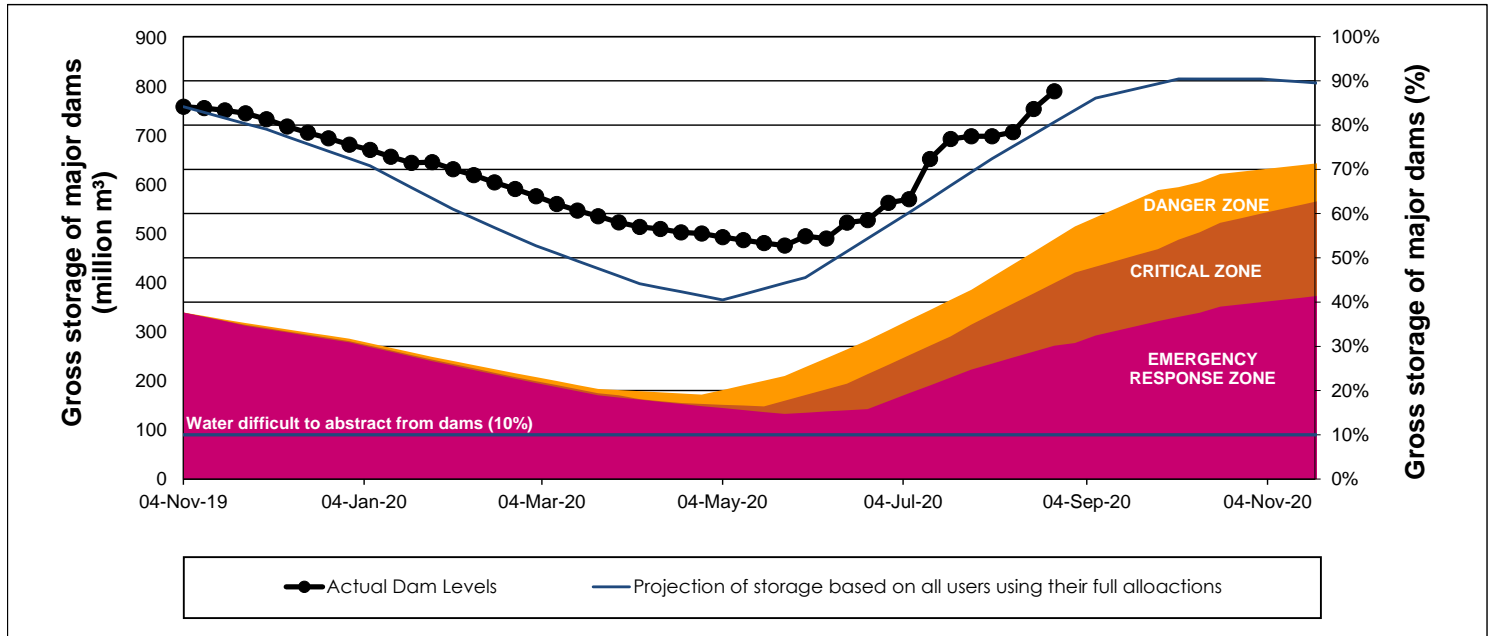

Water Stored in Minor Dams

Overall Percentage Full **91.7**

Weekly Change **2.27**

MINOR DAMS	STORAGE						
	CAPACITY	%	%	%	%	%	%
	MI	24 August 2020	Previous week	2019	2018	2017	2016
ALEXANDRA (Table Mountain)	126	98.3	98.3	56.1	85.2	72.3	46.7
DE VILLIERS (Table Mountain)	243	100.0	101.2	99.1	100.2	79.7	100.2
HELY-HUTCHINSON (Table Mountain)	925	99.5	100.7	99.5	93.6	100.3	100.3
KLEINPLAATS (Simon's Town)	1 368	81.8	74.1	81.4	83.2	56.9	95.6
LAND-EN-ZEEZICHT (Helderberg)	451	85.7	83.5	76.9	100.0	68.0	56.3
LEWIS GAY (Simon's Town)	182	100.9	92.6	91.7	66.3	94.3	100.7
VICTORIA (Table Mountain)	128	99.6	102.3	99.3	101.9	100.8	87.8
WOODHEAD (Table Mountain)	954	99.8	100.5	86.6	55.1	97.3	100.6
Total Stored	4 377	4012.8	3913.3	3765.8	3545.1	3496.3	3985.0
Percentages stored		91.7	89.4	86.0	81.0	79.9	91.0


Rainfall Recorded

RAINFALL (mm)	18-Aug	19-Aug	20-Aug	21-Aug	22-Aug	23-Aug	24-Aug	Aug	
								Total*	LT Average
Blackheath Upper	12.0	0.0	0.0	0.0	0.0	0.0	0.0	50.2	77.7
Brooklands	16.0	0.0	7.0	0.0	0.0	0.0	0.0	110.0	135.1
Newlands	33.0	0.0	0.0	3.0	0.0	0.0	0.0	227.5	237.0
Steenbras	20.0	0.0	3.0	8.0	0.0	0.0	0.0	191.3	127.1
Table Mountain (Woodhead)	0.0	0.0	7.0	5.0	0.0	0.0	0.0	171.5	215.8
Theewaterskloof	10.0	3.4	0.0	0.0	0.0	0.0	1.0	61.7	76.0
Tygerberg	18.0	0.0	0.0	0.0	0.0	0.0	0.0	67.9	86.5
Voëlvlei	14.8	1.0	0.0	0.2	0.0	0.0	0.0	61.8	90.2
Wemmershoek	27.3	3.4	0.0	1.5	0.0	0.0	0.0	166.1	146.0
Wynberg	27.0	0.0	0.0	0.0	0.0	0.0	0.0	161.5	191.1

Notes: *Total/cummulative rainfall for month indicated above
LT: Long Term

Accumulated Monthly Rainfall at Wemmershoek

Note: Wemmershoek station used due to long record and mountaneous location

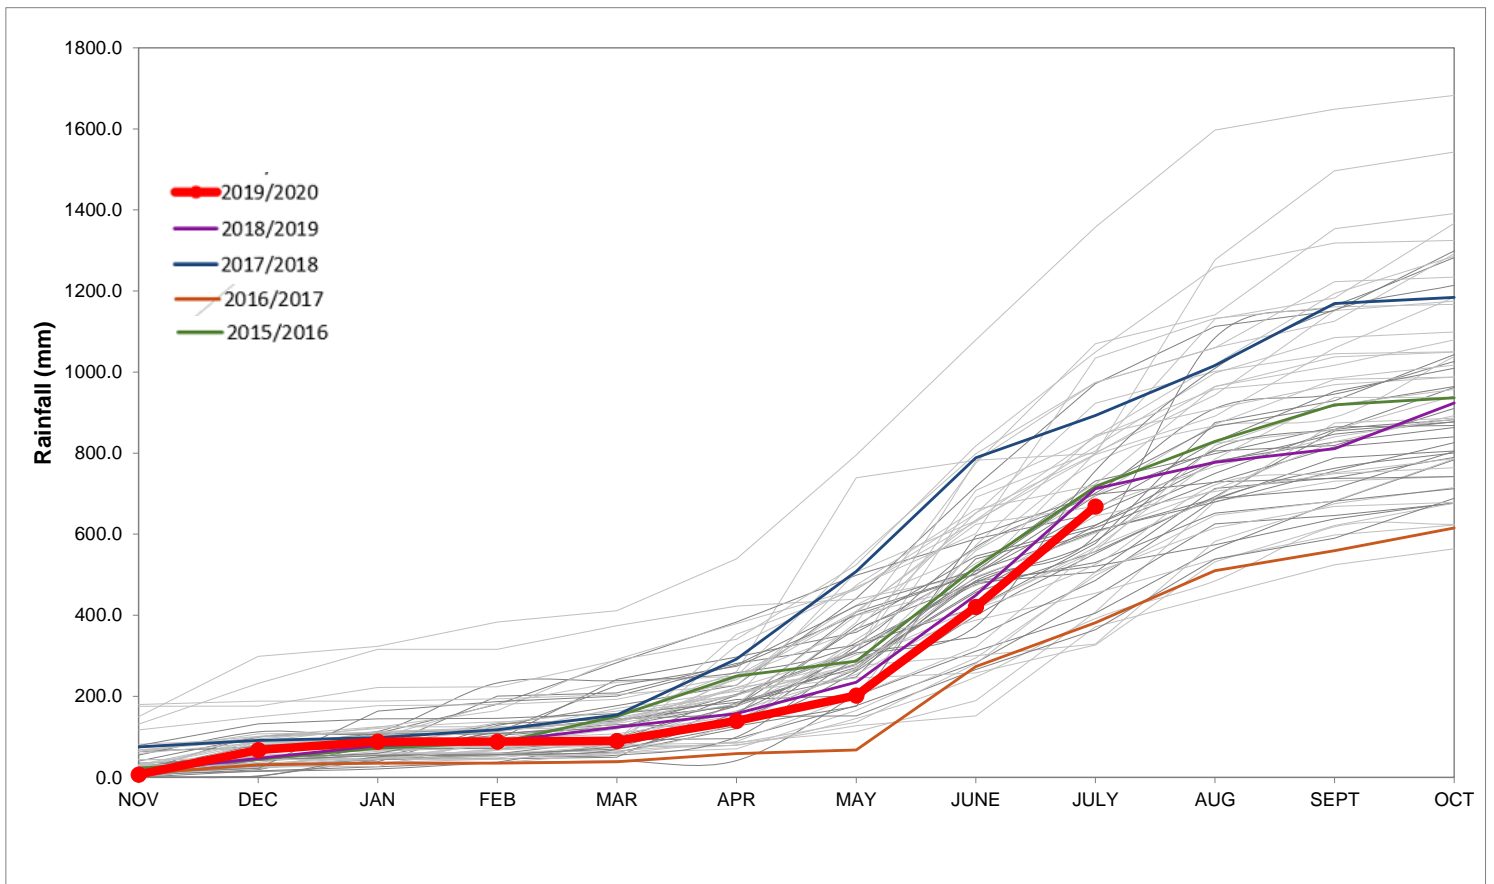

Drinking Water Quality

SAMPLE PASS RATE

Month	Water Quality Compliance (%)	Target (%)
Apr-19	99.10	98
May-19	99.08	98
Jun-19	99.09	98
Jul-19	99.04	98
Aug-19	99.02	98
Sep-19	98.99	98
Oct-19	99.03	98
Nov-19	99.14	98
Dec-19	99.09	98
Jan-20	99.07	98
Feb-20	99.08	98
Mar-20	99.17	98
Apr-20	99.16	98
May-20	99.20	98
Jun-20	99.19	98

Notes:

This table shows CCT drinking water quality compliance according to the South African National Standard 241:2015. Compliance, measured against all prescribed chemical and microbiological components, consistently exceeds the very high CCT target of 98%. (Overall compliance percentages of continuous sampling and analysis are released on a monthly basis.)